




TDS	Date	Page	Product	Issued by	Revised
B15	2015-01-04	1/1	KBS FOAMCOAT	M.S	-

TDS B15: Principle description - Fire sealing electrical cables with **KBS FOAMCOAT HS!**

KBS FOAMCOAT HS! is a heat-intumescent fire putty, used for fire sealing of penetrations with plastic pipes and electric cables.

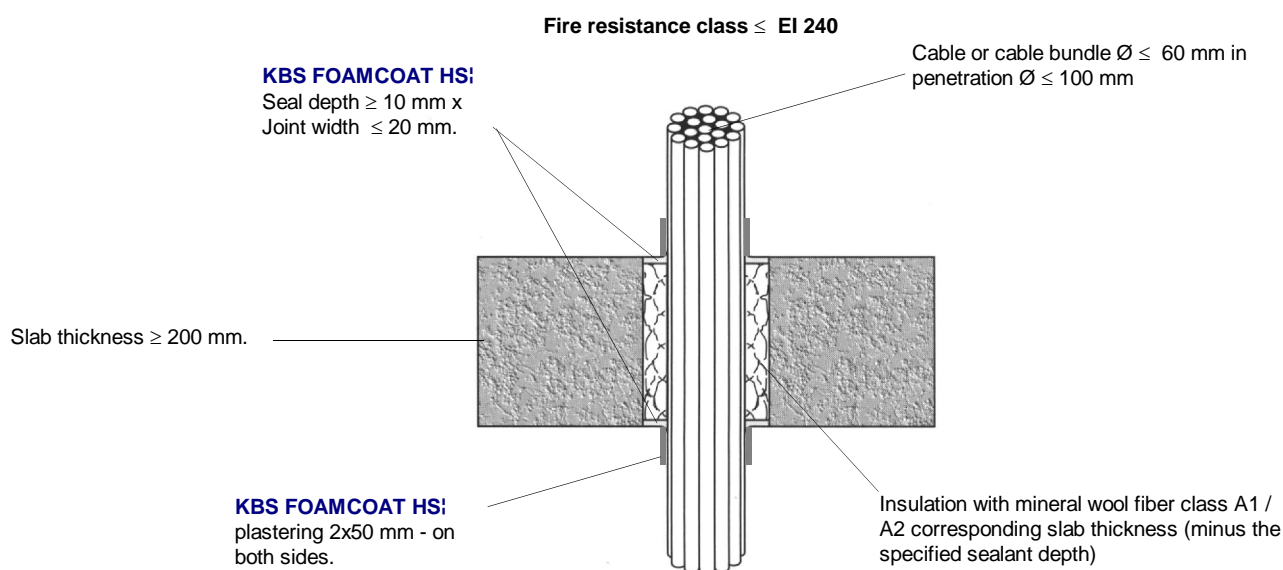

Recommended use:

1. The fire-limiting thickness of the structure must be at least 200mm.
2. Fill the space around the cable / cables with loose non-combustible mineral wool (Euro Class A1 or A2).
3. Save at least 10 mm depth on both sides and fill with **KBS FOAMCOAT HS!**
4. The sealing gap between the cable / cables and fire-limiting construction should not exceed 20 mm.
5. Apply 2mm **FOAMCOAT HS!** 50 mm on cable / cables on both sides.

Internref # : 1106 / 1208

Postaddress
Postal address

KBS BRANDSKYDD AB
Nåås Fabriker 5016
SE 448 51 TOLLERED
Sweden

Telefon
Telephone

Nat 031-7851890
Int +46 31 7851890

Telefax
Telefax

Nat 031-7851891
Int +46 31 7851891

E-post
E-mail

info@kbs.se
www.kbs.se

Org.nr/
Reg. number VAT

556343-3498
SE 556343349801

© Reg. Trademark. 1983